



NVLAP LAB CODE 500080-0

Ref. No.: LCZF17090513

Version: 1.0

Date of issue: Sep. 29, 2017

Total pages: 12



Test report of

IES LM-79-08

Approved Method: Electrical and Photometric Measurements of Solid-State Lighting Products

Rendered to:

ETI Solid State Lighting (Zhuhai) Ltd
No.1, Zhongzhu Road South, Science & Technology Innovation
Coast, High Tech District, Zhuhai City, Guangdong Prov., China

For products:

2x2 Luminaires for Ambient Lighting of Interior Commercial
Spaces

Models No.:

FPE-22-40-850-MV-D

Test Date: Aug. 23, 2017 to Sep. 28, 2017

Test Item: Total luminous flux, Luminous Efficacy, Electrical values, Luminous Intensity Distribution, Chromaticity coordinates, CCT and CRI, Spectral Power Distribution.

Test Lab.: **LCTECH (Zhongshan) Testing Service Co., Ltd**

2/F., Technology and Enterprise Development Center, Guangyuan Road, Xiaolan, Zhongshan, Guangdong, China

Tel: +86-760-22833366

Fax: +86-760-22833399

E-mail: Service@lccert.com

<http://www.lccert.com>

Template No.: LC-RT-PL/LM79-08/01

Test Note:

Complied by:

Fish Tan
Project Engineer
Sep. 29, 2017

Reviewed by:

Richard Li
Technical Manager
Sep. 29, 2017

The duplication of this report or parts of it and its use for advertising purposes is only allowed with permission of the testing laboratory. This report contains the result of the examination of the product sample submitted by the applicant. A general statement concerning the quality of the products from the series manufacture cannot be derived therefore. This report must not be used by the customer to claim product certification, approval or endorsement by NVLAP, NIST, or any agency of the Federal Government.



Table of Contents

| | |
|---|----|
| 1. General | 3 |
| 1.1 Product Information | 3 |
| 1.2 Standards or methods | 4 |
| 1.3 Equipment list | 4 |
| 2. Test conducted and method | 5 |
| 2.1 Ambient Condition | 5 |
| 2.2 Power Supply Characteristics | 5 |
| 2.3 Seasoning and Stabilization | 5 |
| 2.4 Electrical Instrumentation | 5 |
| 2.5 Color Measurement Method | 5 |
| 2.6 Total Luminous Flux Measurement Method | 5 |
| 2.7 Luminous Intensity Distribution Measurement Method | 5 |
| 2.8 Spatial Non-uniformity of Chromaticity | 5 |
| 3. Test Result Summary | 6 |
| 3.1 Electrical data | 6 |
| 3.2 Photometric data | 6 |
| 3.3 Color Rendering Details | 6 |
| 4. Test Data | 7 |
| 4.1 Spectral Distribution | 7 |
| 4.2 ANSI Chromaticity Quadrangles Diagram | 7 |
| 4.3 Goniometry Test Data | 8 |
| 4.4 Zonal Lumen Summary | 8 |
| 4.5 Polar Curves | 9 |
| 4.6 Candela Tabulation | 10 |
| Appendix 1 Product Photo | 11 |
| Appendix 2 U.S. Department of Energy Lighting Facts CM Uniform LM-79 Reporting Template .. | 12 |



LCTECH



1. General

1.1 Product Information

| | |
|------------------------------|--|
| Brand Name | ETI |
| Product Type | 2x2Luminaires for Ambient Lighting of Interior Commercial Spaces |
| Model Number | FPE-22-40-850-MV-D |
| Rated Inputs | 100-277VAC, 50/60Hz |
| Rated Power | 40W |
| Rated Light output | 4000lm |
| Declared CCT | 5000K |
| Power Supply | MPU45D-40E |
| LED Package, Array or Module | 67-21S Series, EVERLIGHT ELECTRONICS CO., LTD |
| Dimming Information | Dimmable |
| Receipt Samples | 1 unit |
| Sample Code of lab. | 170819105002 |
| Date of Receipt Samples | Aug. 19, 2017 |
| Note | - |



LCTECH



1.2 Standards or methods

The following standards are partly or totally used or referenced for test:

| No. | Name |
|----------------------------------|--|
| ANSI/NEMA/ ANSLG C78.377-2011 | Specifications for the Chromaticity of Solid State Lighting Products |
| ANSI C82.77-2002 | Harmonic Emission Limits—Related Power Quality Requirements for Lighting Equipment |
| CIE Pub. No. 13.3-1995 | Method of Measuring and Specifying Color Rendering of Light Sources |
| CIE Pub. No. 15:2004 | Colorimetry |
| IES LM-79-08 | Electrical and Photometric Measurements of Solid-State Lighting Products |

1.3 Equipment list

| Instrument | ID | Model name | Cal. date | Next cal. Date |
|---|-------------|------------|------------|----------------|
| AC Power supply | LC-I-923 | CHP-500 | 2017-02-04 | 2018-02-03 |
| AC Power supply | LC-I-987 | APW-110N | 2017-02-04 | 2018-02-03 |
| Power analyzer | LC-I-928 | WT210 | 2017-01-19 | 2018-01-19 |
| Power analyzer | LC-I-954 | WT210 | 2017-02-04 | 2018-02-03 |
| Multimeter | LC-I-972 | Fluke 17B | 2017-08-10 | 2018-08-09 |
| Photometric colorimetric electric system (2 meter sphere) | LC-I-900 | SPR3000 | Before use | Before use |
| Standard lamp | LC-I-963 | 24V/50W | 2016-11-03 | 2017-11-03 |
| Standard lamp | LC-PL-I-003 | 110V/200W | 2017-09-22 | 2018-09-21 |
| Goniophotometer(with mirror) | LC-I-902 | GMS2000 | 2017-05-07 | 2018-05-06 |
| Wireless temperature transmitter | LC-I-978 | DWRF-B | 2017-02-10 | 2018-02-10 |
| Wireless temperature transmitter | LC-I-979 | DWRF-B | 2017-02-10 | 2018-02-10 |

2. Test conducted and method

The luminaire was operated at least 2 hours to reach stabilization and temperature equilibrium before test.

2.1 Ambient Condition

The ambient temperature in which measurements are being taken was maintained at $25\text{ }^{\circ}\text{C} \pm 1\text{ }^{\circ}\text{C}$; the air flow around the sample(s) being tested did not affect the performance.

2.2 Power Supply Characteristics

The AC power supply had a sinusoidal voltage wave shape at the prescribed frequency (60 Hz) such that the RMS summation of the harmonic components does not exceed 3 percent of the fundamental during operation of the test item.

The voltage of AC power supply (RMS voltage) applied to the device under test was regulated to within ± 0.2 percent under load.

2.3 Seasoning and Stabilization

No seasoning was performed in accordance with IESNA LM-79-08. And before the measurement, the sample was stabilized until the light output and power variations were less than 0.5% in 30 minutes intervals (3 readings, 15 minutes apart).

2.4 Electrical Instrumentation

The calibration uncertainties of the instruments for AC voltage and current were less than 0.2 percent, and the calibration uncertainty of the AC power meter was less than 0.5 percent (95 % confidence interval, $k=2$).

2.5 Color Measurement Method

Spectral radiant flux was measured by a sphere (2 meter)-spectroradiometer system, and the color characteristics (Color rendering index, correlated color temperature, chromaticity coordinate) were calculated from these by software automatically.

2.6 Total Luminous Flux Measurement Method

Total luminous flux was measured by type C goniophotometer system.

Light intensity distribution was measured by a type C goniophotometer (with mirror) which can keep the sample in burn position when the tests conduct, and the total luminous flux was calculated from the intensity data by software automatically.

2.7 Luminous Intensity Distribution Measurement Method

Luminous intensity distribution was measured by a mirror-type goniophotometer (Type C) which can keep the sample in burn position when the tests conduct, and the kinds of graph were generated by software automatically.

2.8 Spatial Non-uniformity of Chromaticity

The customer did not require this measurement.



LCTECH



3. Test Result Summary

3.1 Electrical data

| Criteria Item | Result(Sphere) | Result(Goniophotometer) |
|---------------------------|----------------|-------------------------|
| Input Voltage & Frequency | 120.00 V~60Hz | 120.01 V~60Hz |
| Input Current(A) | 0.336 | 0.335 |
| Total Power(W) | 40.00 | 39.91 |
| Power Factor | 0.994 | 0.993 |
| I-THD | 3.92 % | - |
| Off-state Power(W) | - | - |

3.2 Photometric data

| Criteria Item | Result(Sphere) | Result(Goniophotometer) |
|---------------------------------------|-------------------------|-------------------------|
| Total Lumens(lm) | - | 4302.96 |
| Luminaire Efficacy(Lm/W) | - | 107.82 |
| Correlated Color Temperature (CCT)(K) | 4799 | - |
| Color Rendering Index (CRI) | 82.7 | - |
| R9 | 11 | - |
| Chromaticity Coordinate (x,y) | x = 0.3525 y = 0.3683 | - |
| Chromaticity Coordinate (u,v) | u = 0.2100 v = 0.3291 | - |
| Chromaticity Coordinate (u',v') | u' = 0.2100 v' = 0.4936 | - |
| Duv | 0.0053 | - |
| Zone Lumens between 0-60 ° | - | 77.66% |


3.3 Color Rendering Details

| | | | | | | | |
|----|-----|-----|-----|-----|-----|-----|----|
| R1 | R2 | R3 | R4 | R5 | R6 | R7 | R8 |
| 80 | 86 | 92 | 83 | 81 | 82 | 89 | 69 |
| R9 | R10 | R11 | R12 | R13 | R14 | R15 | - |
| 11 | 69 | 82 | 59 | 81 | 96 | 74 | - |


Note: N.A.

4. Test Data

4.1 Spectral Distribution

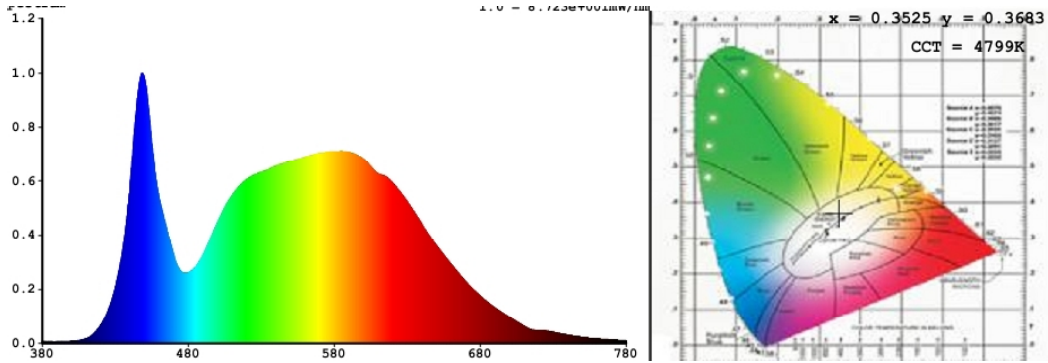

4.2 ANSI Chromaticity Quadrangles Diagram

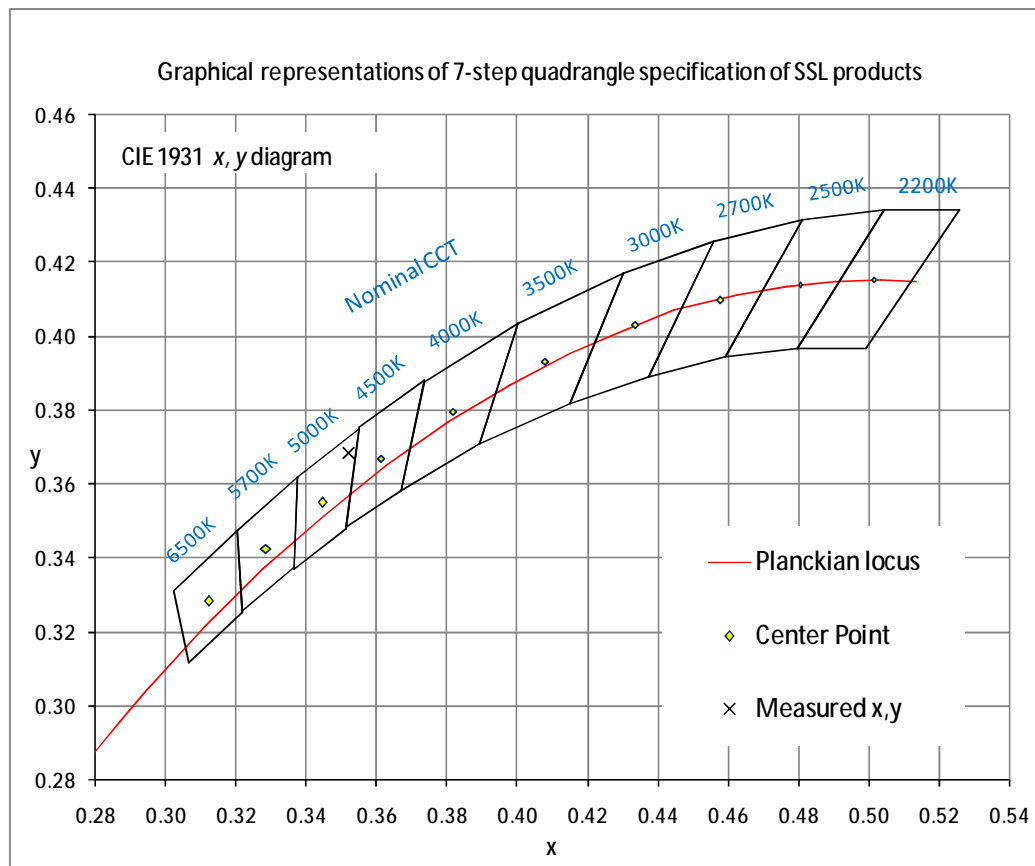



LCTECH



4.3 Goniometry Test Data

| | | | |
|-----------------------------|---------|----------------------|-------------|
| CIE Type | Direct | Basic Luminous Shape | Rectangular |
| Spacing Criteria (0-180) | 1.26 | Luminous Length | 0.56 m |
| Spacing Criteria (90-270) | 1.28 | Luminous Width | 0.56 m |
| Spacing Criteria (Diagonal) | 1.40 | Luminous Height | 0.00 m |
| Test Distance | 29.79 m | | |

4.4 Zonal Lumen Summary

| Zone | Lumens | %Lamp | %Fixt |
|---------|---------|--------|--------|
| 0-20 | 539.20 | 12.50 | 12.50 |
| 0-30 | 1146.62 | 26.60 | 26.60 |
| 0-40 | 1881.49 | 43.70 | 43.70 |
| 0-60 | 3342.03 | 77.70 | 77.70 |
| 0-80 | 4193.09 | 97.40 | 97.40 |
| 0-90 | 4291.03 | 99.70 | 99.70 |
| 10-90 | 4151.59 | 96.50 | 96.50 |
| 20-40 | 1342.29 | 31.20 | 31.20 |
| 20-50 | 2107.68 | 49.00 | 49.00 |
| 40-70 | 1994.73 | 46.40 | 46.40 |
| 60-80 | 851.06 | 19.80 | 19.80 |
| 70-80 | 316.87 | 7.40 | 7.40 |
| 80-90 | 97.94 | 2.30 | 2.30 |
| 90-110 | 4.00 | 0.10 | 0.10 |
| 90-120 | 5.45 | 0.10 | 0.10 |
| 90-130 | 6.88 | 0.20 | 0.20 |
| 90-150 | 9.30 | 0.20 | 0.20 |
| 90-180 | 11.94 | 0.30 | 0.30 |
| 110-180 | 7.94 | 0.20 | 0.20 |
| 0-180 | 4302.96 | 100.00 | 100.00 |

Total Luminaire Efficiency = 100.00%


ZONAL LUMEN SUMMARY

| Zone | Lumens |
|---------|--------|
| 0-10 | 139.43 |
| 10-20 | 399.76 |
| 20-30 | 607.43 |
| 30-40 | 734.87 |
| 40-50 | 765.38 |
| 50-60 | 695.16 |
| 60-70 | 534.19 |
| 70-80 | 316.87 |
| 80-90 | 97.94 |
| 90-100 | 2.37 |
| 100-110 | 1.63 |
| 110-120 | 1.45 |
| 120-130 | 1.43 |
| 130-140 | 1.16 |
| 140-150 | 1.26 |
| 150-160 | 1.25 |
| 160-170 | 1.00 |
| 170-180 | 0.39 |



LCTECH

4.5 Polar Curves

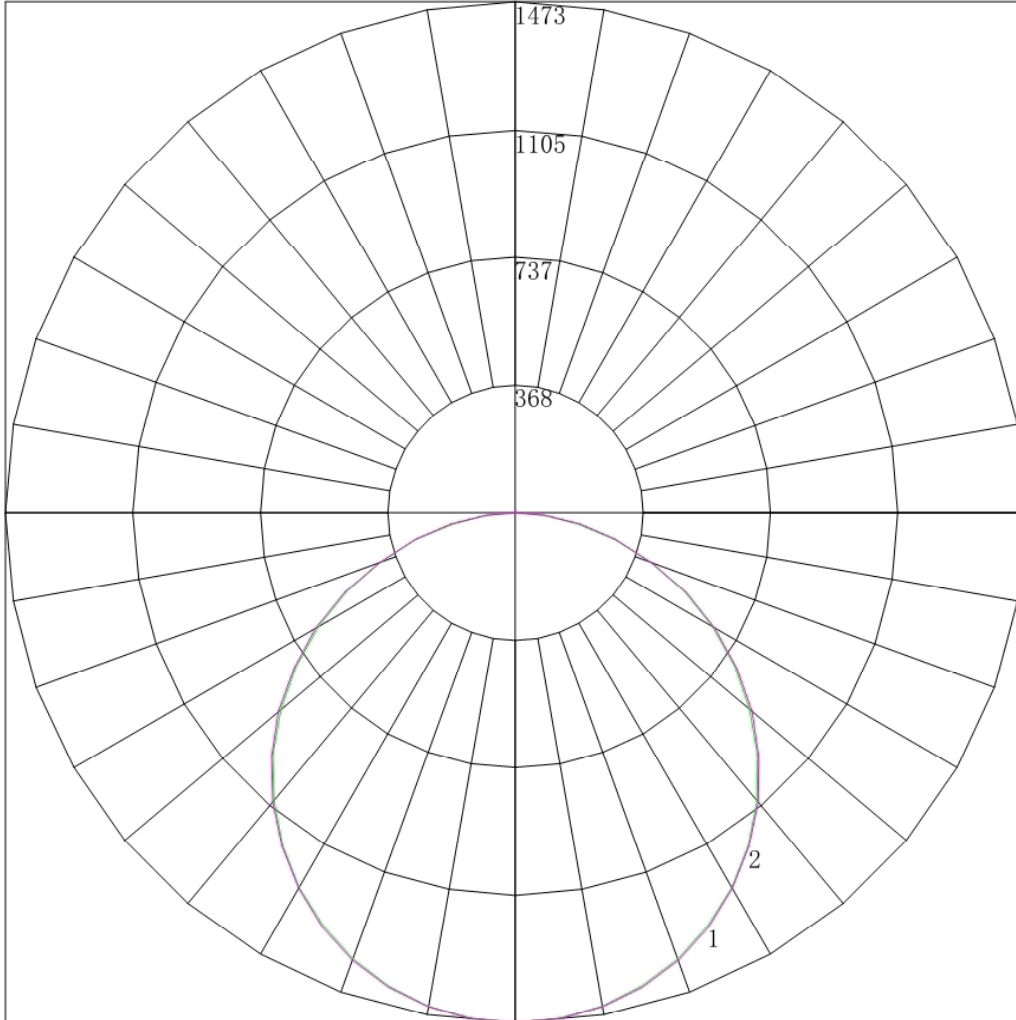

Maximum Candela = 1473.367 Located At Horizontal Angle = 0, Vertical Angle = 0
1 - Vertical Plane Through Horizontal Angles (0 - 180)
2 - Vertical Plane Through Horizontal Angles (90 - 270)




LCTECH




4.6 Candela Tabulation

| | <u>0</u> | <u>15</u> | <u>30</u> | <u>45</u> | <u>60</u> | <u>75</u> | <u>90</u> |
|------------|----------|-----------|-----------|-----------|-----------|-----------|-----------|
| 0 | 1473.367 | 1473.367 | 1473.367 | 1473.367 | 1473.367 | 1473.367 | 1473.367 |
| 5 | 1467.023 | 1467.462 | 1466.864 | 1466.782 | 1466.911 | 1467.024 | 1468.850 |
| 10 | 1447.459 | 1447.659 | 1447.467 | 1447.404 | 1448.054 | 1447.930 | 1450.246 |
| 15 | 1414.853 | 1415.736 | 1416.352 | 1415.788 | 1416.351 | 1415.930 | 1418.533 |
| 20 | 1371.777 | 1371.691 | 1372.321 | 1372.776 | 1373.733 | 1373.927 | 1376.322 |
| 25 | 1316.013 | 1316.835 | 1316.727 | 1317.836 | 1318.203 | 1318.774 | 1320.424 |
| 30 | 1250.490 | 1250.834 | 1250.702 | 1251.699 | 1253.423 | 1253.531 | 1253.144 |
| 35 | 1172.767 | 1173.090 | 1173.868 | 1174.432 | 1176.129 | 1175.802 | 1176.342 |
| 40 | 1085.772 | 1085.734 | 1086.827 | 1089.694 | 1088.031 | 1089.956 | 1091.342 |
| 45 | 989.816 | 988.764 | 991.973 | 992.983 | 994.077 | 995.329 | 995.227 |
| 50 | 883.878 | 887.021 | 887.287 | 887.514 | 890.738 | 890.345 | 892.828 |
| 55 | 773.948 | 775.933 | 778.141 | 778.054 | 781.631 | 779.817 | 780.592 |
| 60 | 656.698 | 658.185 | 659.074 | 660.215 | 662.407 | 663.856 | 665.787 |
| 65 | 538.028 | 536.640 | 538.542 | 538.428 | 540.765 | 542.284 | 542.877 |
| 70 | 414.301 | 416.671 | 418.365 | 416.132 | 419.346 | 419.248 | 419.037 |
| 75 | 296.519 | 296.925 | 298.433 | 298.624 | 299.412 | 299.273 | 298.831 |
| 80 | 182.463 | 184.460 | 185.602 | 185.750 | 186.422 | 189.632 | 189.074 |
| 85 | 84.644 | 83.938 | 83.824 | 83.629 | 85.369 | 86.489 | 86.094 |
| 90 | 3.948 | 3.641 | 4.350 | 3.658 | 4.459 | 4.324 | 2.569 |
| 95 | 1.641 | 1.643 | 1.620 | 1.596 | 1.597 | 1.552 | 1.551 |
| 100 | 1.641 | 1.576 | 1.487 | 1.596 | 1.509 | 1.508 | 1.507 |
| 105 | 1.597 | 1.598 | 1.576 | 1.552 | 1.575 | 1.530 | 1.507 |
| 110 | 1.464 | 1.510 | 1.465 | 1.463 | 1.464 | 1.486 | 1.507 |
| 115 | 1.508 | 1.465 | 1.376 | 1.419 | 1.398 | 1.397 | 1.462 |
| 120 | 1.597 | 1.532 | 1.509 | 1.508 | 1.486 | 1.508 | 1.506 |
| 125 | 1.641 | 1.687 | 1.620 | 1.685 | 1.620 | 1.708 | 1.683 |
| 130 | 1.553 | 1.532 | 1.576 | 1.552 | 1.531 | 1.552 | 1.506 |
| 135 | 1.375 | 1.399 | 1.420 | 1.397 | 1.420 | 1.353 | 1.373 |
| 140 | 1.730 | 1.709 | 1.687 | 1.707 | 1.708 | 1.641 | 1.639 |
| 145 | 2.041 | 1.998 | 1.997 | 2.018 | 2.085 | 2.040 | 1.993 |
| 150 | 2.351 | 2.287 | 2.242 | 2.261 | 2.285 | 2.284 | 2.391 |
| 155 | 2.662 | 2.686 | 2.774 | 2.705 | 2.707 | 2.728 | 2.657 |
| 160 | 3.150 | 3.197 | 3.174 | 3.170 | 3.217 | 3.193 | 3.188 |
| 165 | 3.549 | 3.530 | 3.573 | 3.547 | 3.572 | 3.570 | 3.631 |
| 170 | 3.860 | 3.885 | 3.817 | 3.791 | 3.838 | 3.859 | 3.897 |
| 175 | 4.126 | 4.174 | 4.195 | 4.190 | 4.215 | 4.191 | 4.163 |
| 180 | 4.309 | 4.309 | 4.309 | 4.309 | 4.309 | 4.309 | 4.309 |

Appendix 1 Product Photo

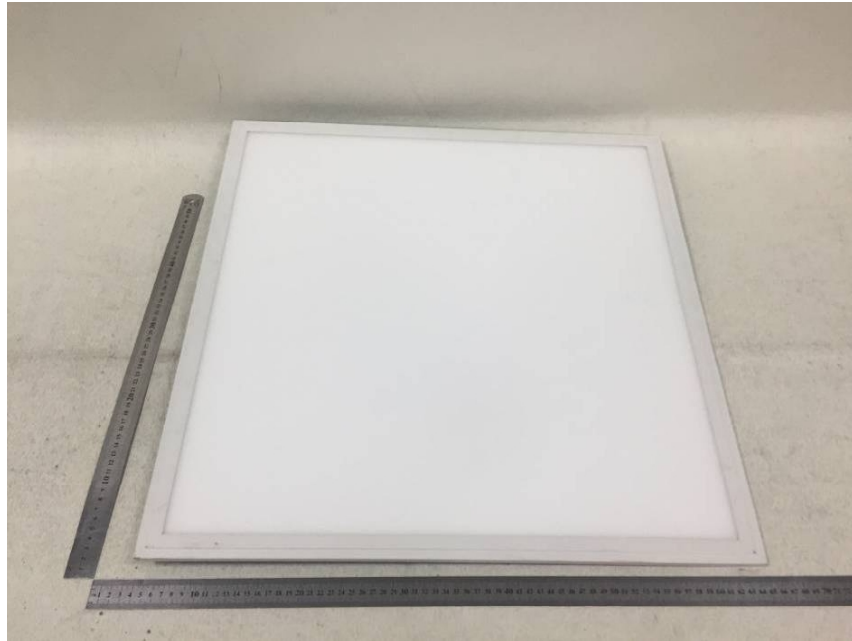

Picture 1

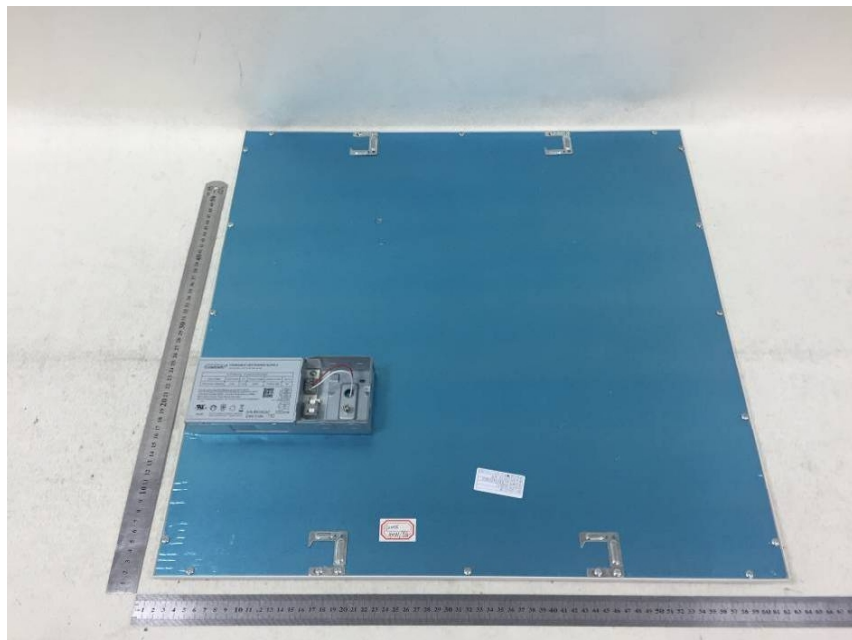

Picture 2



LCTECH



Appendix 2 U.S. Department of Energy Lighting Facts CM Uniform LM-79 Reporting Template

Laboratory Information

| | |
|-------------------------|---|
| Name of test lab | LCTECH (Zhongshan) Testing Service Co., Ltd |
| Date of test report | Sep. 29, 2017 |
| Test report number | LCZP17090513 |
| Laboratory contact name | Richard Li |

Product Information

| | | |
|--|---|-----|
| Applicant | ETI Solid State Lighting (Zhuhai) Ltd | |
| Brand name | ETI | |
| Model number | FPE-22-40-850-MV-D | |
| SKU(if available) | N/A | |
| Type of luminaire (for integral lamps, list base type and lamp type) | 2x2 Luminaires for Ambient Lighting of Interior Commercial Spaces | |
| Luminaire aperture | - | in. |
| Luminaire height | 0.00 | in. |
| Luminaire length | 22.0 | in. |
| Luminaire width | 22.0 | in. |
| Number of units(modular products) | N/A | |

| Electrical Measurements | Integrating sphere output | Goniophotometer Output | |
|-------------------------|---------------------------|------------------------|---|
| Input wattage | 40.00 | 39.91 | W |
| Input current | 0.336 | 0.335 | A |
| Input voltage(AC) | 120.00 | 120.01 | V |
| Power factor | 0.994 | 0.993 | |
| Off-state power | 0.0 | 0.0 | W |

| Photometric Characteristics | | | |
|------------------------------------|--------|---------|------|
| Total initial lumen output | - | 4302.96 | lm |
| Initial luminaire efficacy | - | 107.82 | lm/W |
| Correlated color temperature / CCT | 4799 | K | |
| Color rendering index/CRI | 82.7 | | |
| Rgvalue | 11 | | |
| Duv | 0.0053 | | |

| Luminous Intensity Distribution | | Goniophotometer Output | |
|---|----|------------------------|----|
| Center beam candle power(if applicable) | -- | 1473.367 | cd |
| Beam angle(if applicable) | | 113.2 | ° |
| Zonallumensinthe0°-60°zone | | 77.67 | % |
| Zonal lumens in the60°-90° zone | | 29.79 | % |
| Zonallumensinthe90°-120°zone | | 0.69 | % |
| Zonallumensinthe120°-180°zone | | 0.15 | % |

****End of test report****